




BASE4
9858 GLADES ROAD, #237
BOCA RATON FLORIDA 33434
1.720.72BASE4 www.base-4.com

SEAL



ISSUE:

Issued for Permit
08.05.2016

PROJECT: 16-018

Hampton Inn & Suites

New Stanton, PA 15672

OWNER:

Stanton Hospitality LLC

52 Blueberry Lane,
Grove City, PA 16127

[illegible]

DATE 2016.08.05

DRAWN BY SJ

CHECKED BY GWV

SCALE	AS NOTED
-------	----------



PROJECT NO. B4-67-1603

SHEET NAME

SITE ELECTRICAL PLAN

SHEET NO.

E200

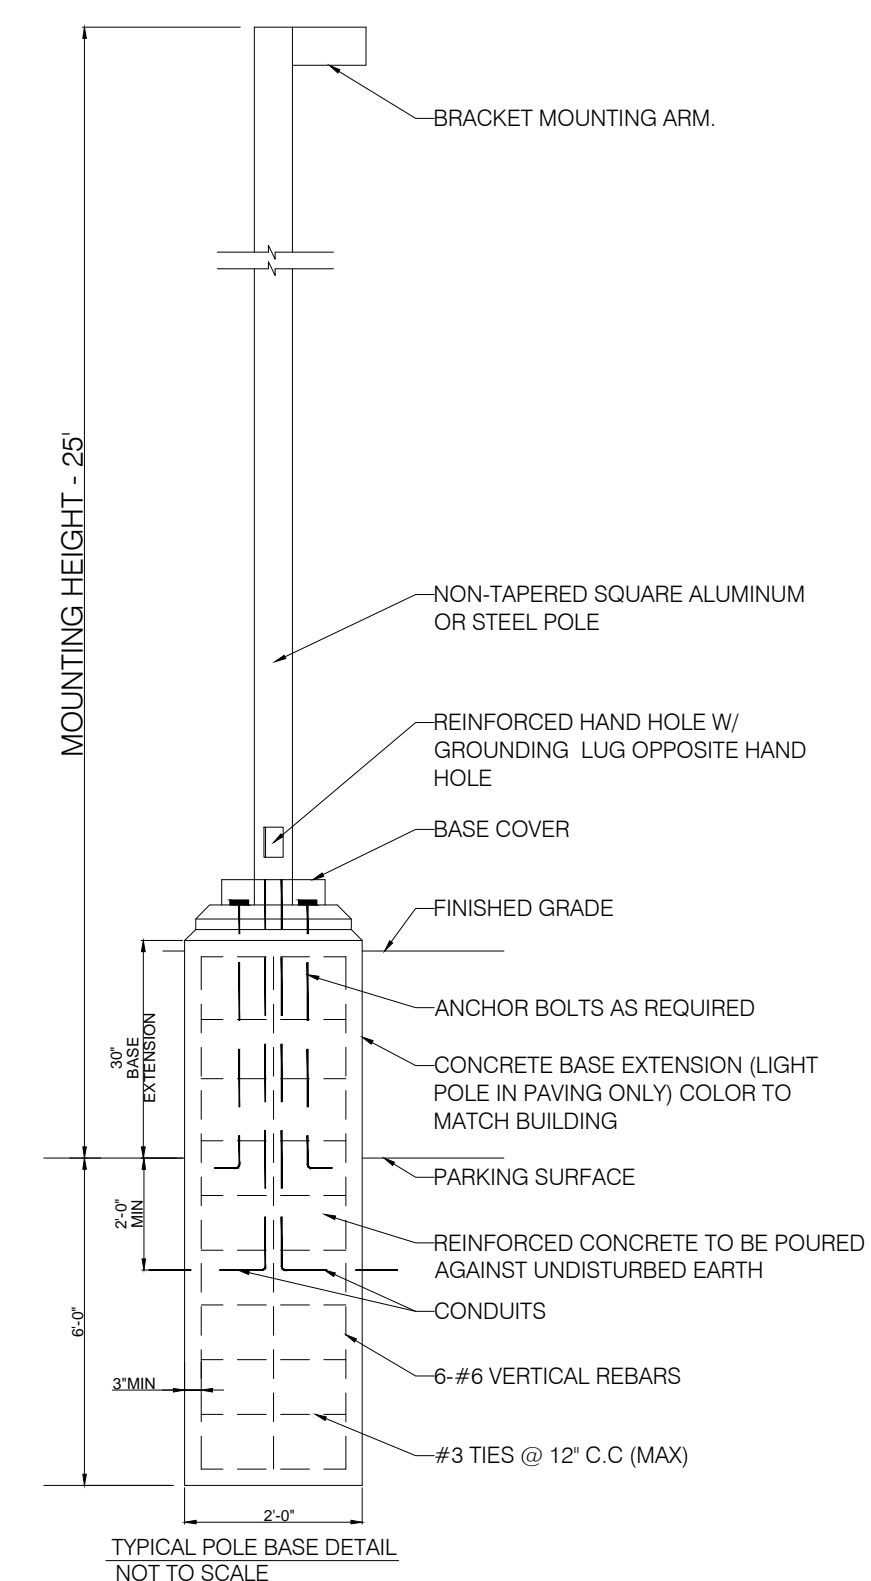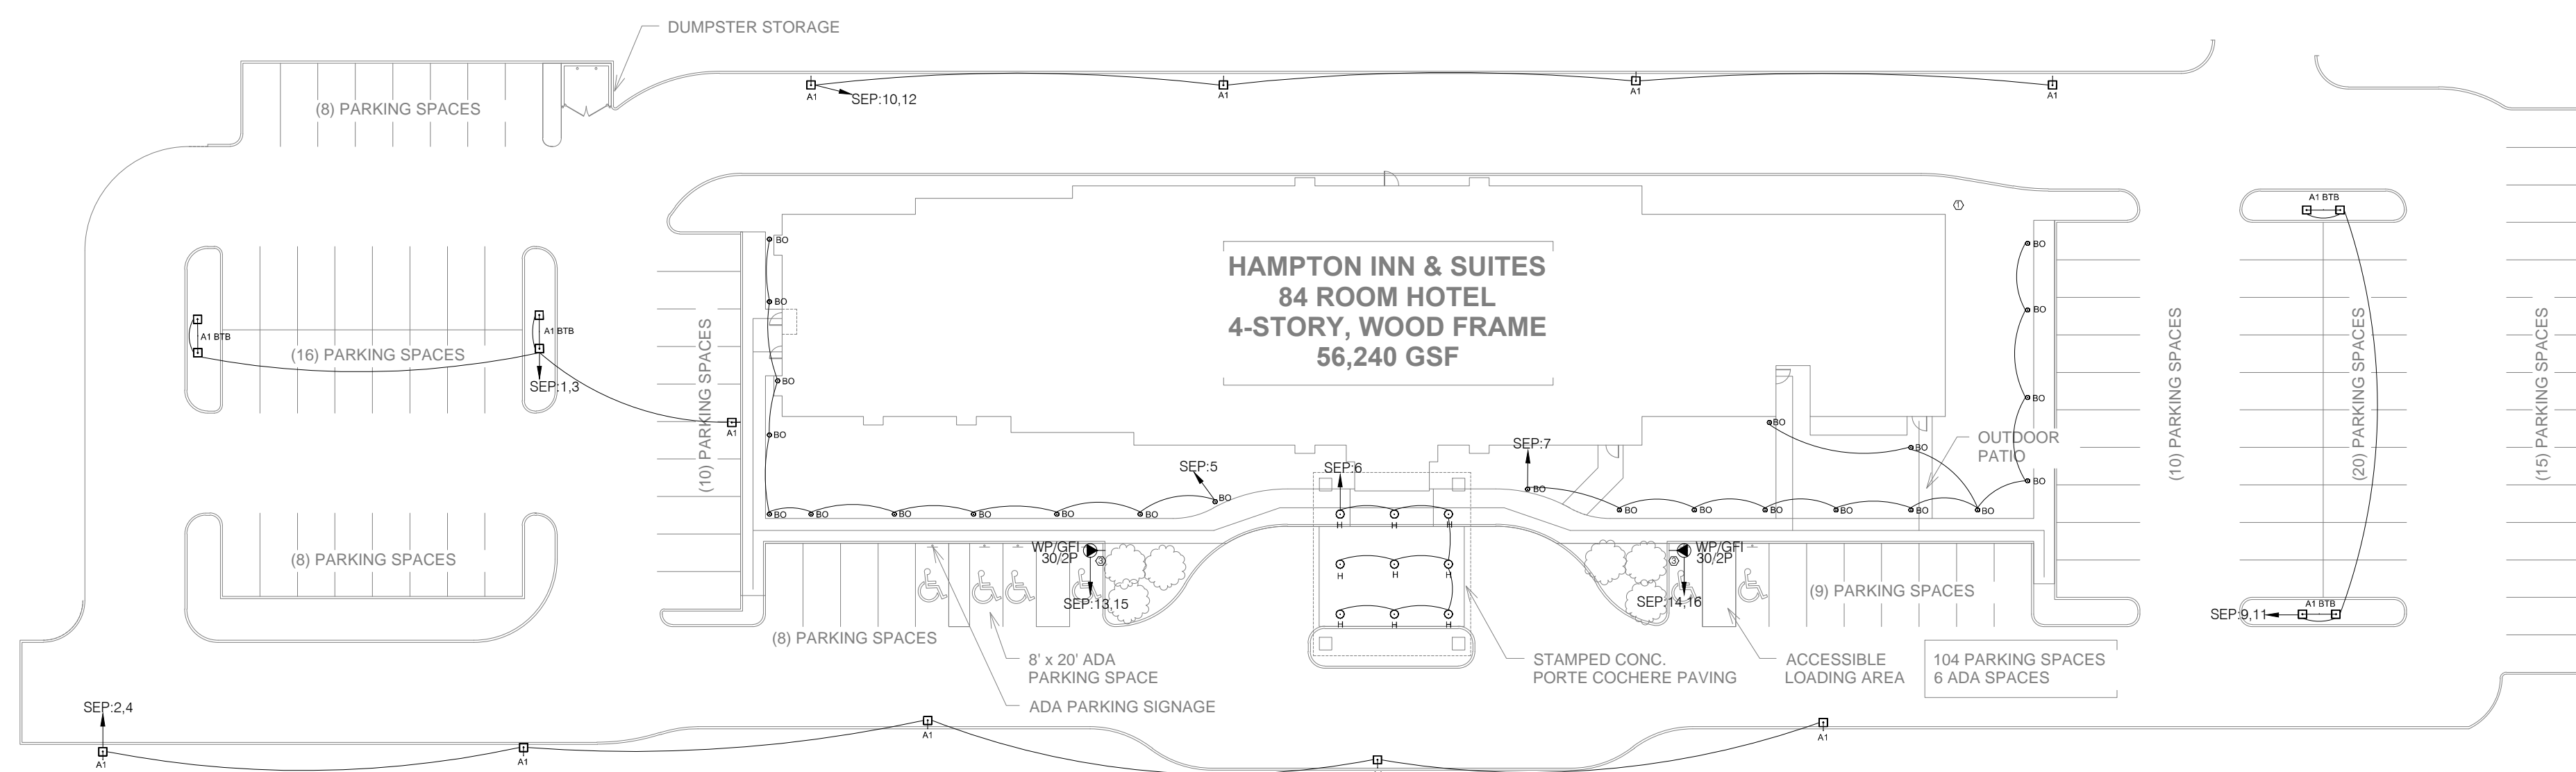

GENERAL NOTES:

1. ALL THE LIGHTING CIRCUITS FOR SITE AREA ARE CONNECTED WITH PHOTOCELL AND THE PHOTOCELL SHALL BE PLACED ON ROOF BY CONTRACTOR.
2. ELECTRICAL CONTRACTOR TO PROVIDE ALL TRENCH AND BACK FILL REQUIRED FOR WORK SHOWN ON PLANS. ALL WORK IS TO COMPLY WITH ELECTRICAL PLAN REQUIREMENTS FOR UNDERGROUND UTILITIES AND TRENCH AND BACKFILL ETC.
3. ALL WIRING IS TO BE #10 AWG AND #10 AWG GROUND MINIMUM THHN/THWN (90 DEG. C.) IN 1" SCHEDULE 40 PVC (MINIMUM SIZE). TRENCH AND BACK FILL TO 30" DEEP. CLEAN BACKFILL USING SITE MATERIALS MAY BE USED. PROVIDE PREMIUM BACKFILL WHERE SITE MATERIALS ARE NOT ACCEPTABLE FOR USE.
4. ALL CONDUIT ENTRIES TO THE BUILDING SHALL PITCH AWAY FROM BUILDING WALLS. SEAL PENETRATIONS WATERTIGHT WITH LINK-SEAL PIPE SEALS OR APPROVED EQUIVALENT.
5. PROVIDE WARNING TAPE ABOVE ALL ELECTRICAL CIRCUITS. WARNING TAPE FOR SITE LIGHTING CIRCUITS TO BE 8" BELOW GRADE, 3" WIDE, RED WITH ELECTRICAL WARNING.
6. POLE BASE COVERS ARE TO BE INSTALLED SO THAT THE BASE COVER FITS FLUSH TO THE TOP OF THE CONCRETE BASE. LEVELING SHIMS AND NUTS SHALL NOT CAUSE A GAP BETWEEN THE POLE BASE AND THE BASE COVER.
7. ALL POLE BASES SHALL HAVE A HONEYCOMBING AND SONOTUBE MARKINGS FILLED AND MADE SMOOTH WITH CONCRETE AFTER TUBE REMOVAL. COAT WITH TWO (2) COATS "THURO-SEAL" PER MANUFACTURER'S DIRECTIONS.
8. POLE BASE DESIGN MUST BE VERIFIED WITH LOCAL GRADE CONDITIONS FOR DENSITY AND CONSISTENCY.
9. CUT AND PATCH EXISTING PAVING AS REQUIRED FOR THE INSTALLATION OF NEW WIRING WHERE PAVING EXISTS.

KEY NOTES:

- | | |
|---|---|
| ① | VERIFY TRANSFORMER LOCATION FROM CIVIL ENGINEER. |
| ② | JUNCTION BOX FOR BUILDING SIGNAGE. |
| ③ | PROVISION TO ADD ELECTRIC CAR CHARGING STATIONS. EXACT LOCATIONS TO BE DETERMINED BY OWNER/ARCHITECT. COORDINATE ALL REQUIREMENTS WITH CHARGING STATION VENDOR. |

01 SITE ELECTRICAL PLAN

SCALE: 1/16" = 1'-0"